

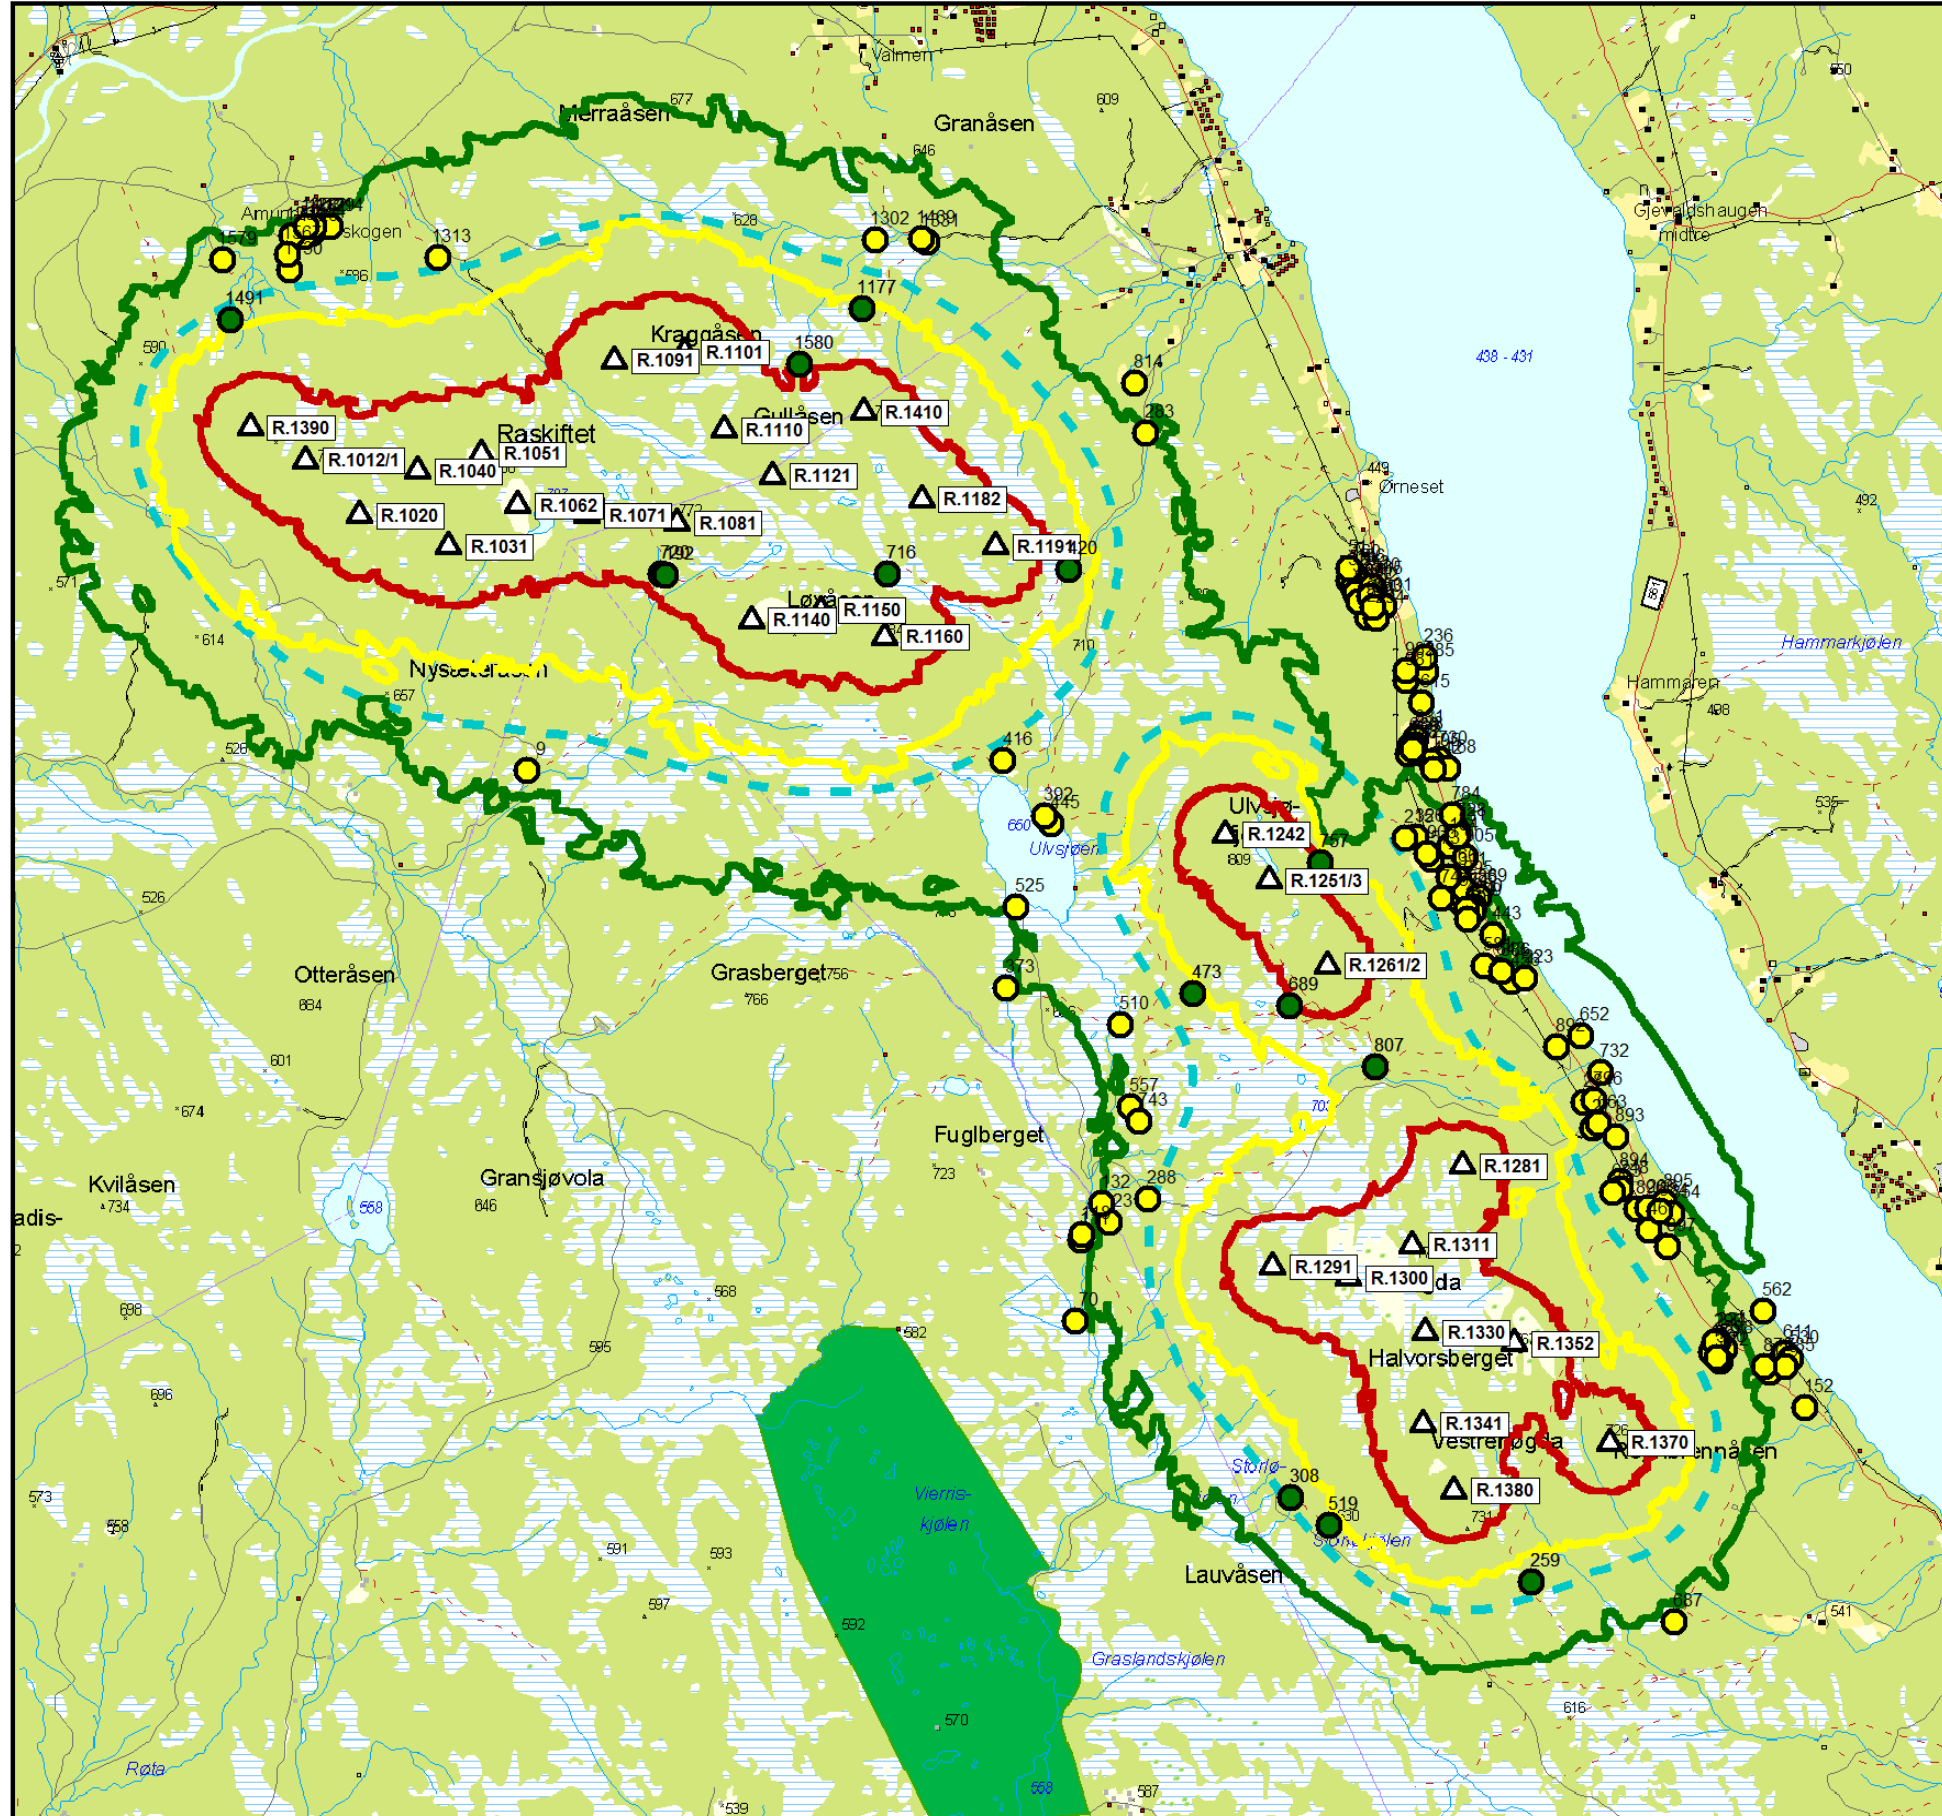


A01- Noise map



Yearly average (290 days) L_{den}
 in dBA
 (Free field value 4,0 m above ground)



- Wind turbine
- NSA - 45 dBA L_{den}
- NSA - Not restricted
- L_{den} 45 dBA zone

Wind farm Raskiftet
Config C - Vestas V126 3,6 MW
 With added uncertainty 1,5 dBA
WT type: Vestas V126 3,6 MW **Number:** 31 **Hub height:** 117 m **Emission:** 104,9 dBA



Handläggare	Paul Appelqvist	Kvalitetsgranskare	Jens Fredriksson
Projekt nr.	10-16019	Ritning	A01
Datum	2016-05-12		